



Technical review and evaluation of the economics of water desalination: Current and future challenges for better water supply sustainability

Noreddine Ghaffour*, Thomas M. Missimer, Gary L. Amy

Water Desalination and Reuse Center, King Abdullah University of Science and Technology (KAUST), KAUST Campus, P.O. Box 4700, ZC 23955-6900, Thuwal, Saudi Arabia

HIGHLIGHTS

- ▶ A techno-economic evaluation and review of desalination costing aspects were highlighted in the paper.
- ▶ Factors that contributed for water cost variation and the parameters influencing the cost were discussed.
- ▶ The impact of recent technology improvements on water cost variation was also discussed.
- ▶ The paper includes recent data on energy consumption and cost trends of different desalination technologies.

ARTICLE INFO

Article history:

Received 23 August 2012
 Received in revised form 10 October 2012
 Accepted 11 October 2012
 Available online 10 November 2012

Keywords:

Desalination cost
 Desalination technologies development
 Energy consumption
 Economics
 Costing methodologies

ABSTRACT

Desalination capacity has rapidly increased in the last decade because of the increase in water demand and a significant reduction in desalination cost as a result of significant technological advances, especially in the reverse osmosis process. The cost of desalinated seawater has fallen below US\$0.50/m³ for a large scale seawater reverse osmosis plant at a specific location and conditions while in other locations the cost is 50% higher (US\$1.00/m³) for a similar facility. In addition to capital and operating costs, other parameters such as local incentives or subsidies may also contribute to the large difference in desalted water cost between regions and facilities. Plant suppliers and consultants have their own cost calculation methodologies, but they are confidential and provide water costs with different accuracies. The few existing costing methodologies and software packages such as WTCost© and DEEP provide an estimated cost with different accuracies and their applications are limited to specific conditions. Most of the available cost estimation tools are of the black box type, which provide few details concerning the parameters and methodologies applied for local conditions. Many desalination plants built recently have greater desalinated water delivery costs caused by special circumstances, such as plant remediation or upgrades, local variation in energy costs, and site-specific issues in raw materials costs (e.g., tariffs and transportation). Therefore, the availability of a more transparent and unique methodology for estimating the cost will help in selecting an appropriate desalination technology suitable for specific locations with consideration of all the parameters influencing the cost. A techno-economic evaluation and review of the costing aspects and the main parameters influencing the total water cost produced by different desalination technologies are herein presented in detail. Some recent developments, such as the increase of unit capacity, improvements in process design and materials, and the use of hybrid systems have contributed to cost reduction as well as reduction in energy consumption. The development of new and emerging low-energy desalination technologies, such as adsorption desalination, will have an impact on cost variation estimation in the future.

© 2012 Elsevier B.V. All rights reserved.

1. Introduction

Many water-stressed or arid regions or countries are augmenting their water supply with desalinated water to meet the increased water demand caused by growth triggered by increased population, industrial expansion, tourism, and agriculture development. In some areas, desalination is no longer a marginal or supplemental water

resource in some countries. Qatar and Kuwait rely 100% on desalinated water for domestic and industrial supplies [1].

Presently, the total global desalination capacity is around 66.4 million m³/d and it is expected to reach about 100 million m³/d by 2015 [2]. Of the global desalted water, 63.7% of the total capacity is produced by membrane processes and 34.2% by thermal processes (Fig. 1-left). The desalination source water is split with about 58.9% from seawater and 21.2% from brackish groundwater sources, and the remaining percentage from surface water and saline wastewater [2]. These figures are constantly changing because the desalination market is growing very rapidly. The growth of desalination capacity worldwide is shown

* Corresponding author. Tel.: +966 28082180.

E-mail address: noreddine.ghaffour@kaust.edu.sa (N. Ghaffour).

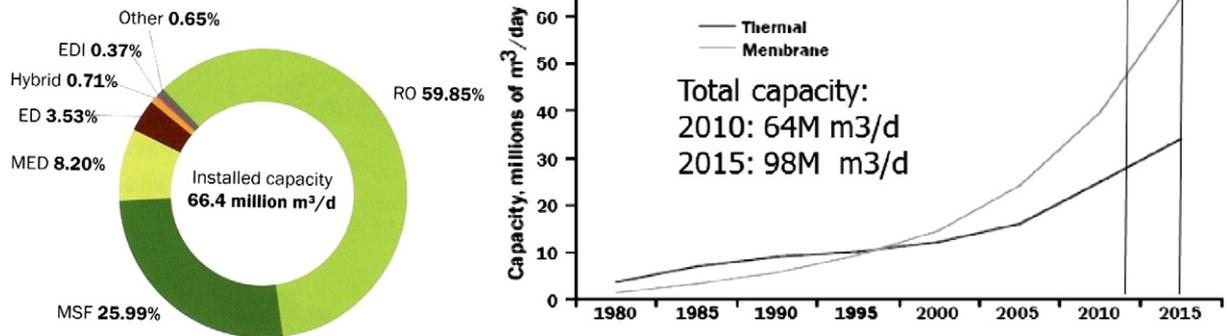


Fig. 1. Installed (left) and forecast (right) desalination capacities by technology (as of first quarter of 2012) [2].

in Fig. 1-right. The growth rate is currently about 55% per year [2], a truly stunning figure.

The increase of desalination capacity is caused primarily not only by increases in water demand but also by the significant reduction in desalination cost as a result of significant technological advances that result in making desalinated water cost-competitive with other water sources. In some specific areas, desalination has now been able to successfully compete with conventional water resources and water transfers for potable water supply (e.g., construction of dams and reservoirs or canal transfers) [3].

A thorough review of technical developments and cost trends of the most commercial desalination processes, including multistage flash distillation (MSF), multi effect distillation (MED), vapor compression (VC), reverse osmosis (RO) and electro dialysis (ED) was presented in earlier studies by Reddy and Ghaffour [4], Wade [5] and Miller [6]. Greenlee et al. [7] also conducted a brief review of the key parameters on seawater reverse osmosis (SWRO) and brackish water reverse osmosis (BWRO), respectively, desalination cost trends.

The main parameters for technology selection for policy/decision makers are the total investment and produced water costs, the type of the project contract, and other parameters such as local incentives or subsidies. In fact, the cost of desalination with different processes is site-specific and depends on many parameters such as feed water salinity and other water quality parameters, plant capacity, energy and labor costs, type of the contract, political and environmental restrictions, and many other factors which are discussed in this paper. Selection of appropriate technology for any specific location thus requires an accurate methodology for each technology. The existing methodologies and software packages are of black box type and other available software packages do not take into consideration all of the parameters influencing the cost and their accuracy is limited to specific conditions [4].

The primary goal of the present paper is to present a review of the costing aspects and evaluate the main parameters influencing the total water cost produced by different desalination technologies. The recent developments that have contributed to cost reduction in different desalination technologies as well as energy consumption and hybrid systems will also be outlined. The main reasons for variation in total water cost of different recent desalination projects are also herein discussed. Also, when evaluating the cost of providing desalinated water, it is quite important to distinguish between the real cost of treating the water by a desalination technology and the actual cost of providing water to the consumer. Commonly, these are inadvertently mixed in various presentations and create confusion in comparisons of desalination cost. The delivery cost of desalted water to consumers includes administrative and conveyance costs and sometimes profit to the provider that have great variation. Some key factors are system losses and water provided without

return of cost (system losses and theft). Therefore, in this analysis, the desalination cost assessment is aimed at true treatment costs.

2. Desalination development potential and market forecast

Desalination has great development potential on a global scale. This is attributed to the fact that, out of 71 largest cities that do not have local access to new fresh water sources, 42 are located along coasts [1]. Out of the entire world population, 2400 million inhabitants representing 39% of the total, live at a distance of less than 100 km from the sea [3].

Other than the fact that desalination may be the only option for some countries, there are driving forces behind its development potential, making it more favorable than conventional resource development. Being independent of climatic conditions, rainfall and so on, a primary force is its identification as a secure source of supply. Desalinated seawater is truly a “new” water source and has an essentially unlimited capacity, not subject to sustainability criteria, although perhaps limited by energy production.

Desalination capacity is continuously increasing worldwide, not only in the Middle East and North Africa (MENA) region where water demand is high and other sources of supply are limited, but also in countries where desalination was unthinkable in the past such as in Spain and Australia (both contain arid and semiarid lands). It is expected that the total desalination market will reach over US\$31 billion by 2015 as shown in Table 1 [8]. About 50% of the total desalination investments are for SWRO projects due mainly to its lower investment and total water cost compared to other conventional source development (where any exist), footprint size, and the continuing technological advances enabling RO desalination to treat higher raw water salinities such as Arabian Gulf seawater. Thermal processes will also continue to be utilized especially where energy is available at low-cost, but the tendency is that MED will replace MSF in future projects and could even compete with SWRO where raw water is highly polluted or of very high salinity. Thermal processes will remain in the market because they have been widely accepted in the Arabian Gulf area. They have a proven record of reliability, are dependable and have the potential for cogeneration

Table 1
Market historical and forecast of desalination systems [8].

Project type	2006–2010 (\$billion USD)	2011–2015 (\$billion USD)
Seawater RO	9.92	15.48
Seawater MED	3.03	4.04
Seawater MSF	8.39	7.07
Small thermal	2.06	2.33
Brackish RO	1.43	2.18
Ultrapure RO	0.21	0.30
Total (\$Billion USD)	25.04	31.40

of power and water (hybrid systems). However, because of the flexibility and simplicity of project bidding parameters and budgeting considerations, several recent SWRO plants were built along with new power plants instead of choosing the co-generation option with a thermal process. This will definitely help to keep the desalination cost stable due to competition with other technologies.

3. Trends in desalination contracts and project finance

The key source to mobilize funding for these projects has been governments, but the size of foreseen investments has many governments convinced that the private sector has a role to play in this development. Also, many governments want to take advantage of private sector advances in technology and management. These factors have resulted in public–private transaction models that have been successful [3]. They are called Independent Water and Power Producers (IWPP). Other project delivery methods include Build Own Operate (BOO) or Build Own Operate Transfer (BOOT) contracts without initial government ownership, but with contract guarantees. Globally today, new projects are delivered with over 58% being privately financed, with Build Own Operate Transfer (BOOT) deliveries accounting for 28.9% and IWPP for 29.7% of the new projects [2].

Growth has also led to the tendency of consulting companies to exceed their conventional design role and become a part owner within a private developer structure for a desalination and/or power plant. Therefore, there is a need for identification and standardization of factors/parameters that contribute to the unit cost of desalinated water for each technology, and development of an appropriate costing methodology that accounts for all of these parameters. The use of different methodologies by different project delivery companies could be one of the causes of the low accuracy in estimating the water cost even for similar projects. If the main parameters influencing the water delivery cost, such as salinity, plant capacity, technology, energy cost, and regulatory requirements, are known in advance, then the total estimated water cost can be ascertainable to a reasonable degree. It is not reasonable that the other few specific parameters, including subsidies, financial and political risks, should affect the price, causing the considerable variations observed in project bidding.

Most of the recent desalination projects are privately-financed water projects under the BOO/BOOT delivery type. The arrangement of BOO involves a long-term supply contract with the client, who is charged accordingly for the services delivered (e.g., water, power, water and power). With a BOOT scheme, the project bid winner undertakes the same functions, but the project is transferred to the client at the end of the supply contract term. Therefore, the most important parameter influencing a BOO project award is the total water cost (TWC), which takes into account all of the parameters discussed above as well as the agreed price of energy and other local contingencies. The BOOT bid evaluation is slightly more complex because the project sponsor must evaluate the residual value of the facility at the end of the contract period. A small cost variation, such as US\$0.01 or less per cubic meter, can make a difference of hundreds of millions of US\$ of investment costs covered by the private sector/banks for a project. The Government subsidies are usually not taken into consideration in the project financing. Within the BOO and BOOT concepts, governments buy the treated water from the companies at a fixed price and sell it to the population at a subsidized price [3]. In some cases, governments partner with local industries to obtain water which may be partially subsidized by the industry, and not the government or an international agency.

4. Trends in desalination costs

When desalination started in the late 1850s, the cost was not as important since the main challenge was to produce fresh water

from seawater for boilers and drinking purposes in ships. Later in the 1960s and early 1970s, desalination technologies (thermal processes) were widely available for commercial production but the cost was still too high. Membrane processes began to compete in the 1970s and started the trend toward cost reduction. As late as 1975, seawater desalination costs were quoted in planning documents as being about US\$2.10/m³ (Southwest Florida Regional Planning Council, 1980) [2].

The expansion of the desalination market has attracted many organizations and companies to improve desalination technologies to reduce the costs. Tremendous decreases in desalination costs were continuously achieved in the last decades causing the water price to reach US\$0.50/m³ [9] for large scale SWRO plants and for specific local conditions and below US\$1.00/m³ for MSF. Technological maturity, system integration, and competition combined to cause the reduction of desalination costs in the last 20 years. Fig. 2 shows the important decrease in the price reaching a factor of 10 for MSF.

Similarly, technological improvements in membrane design and systems integration have also decreased the desalinated brackish water cost down by over half in the last two decades. In some systems, the amount of energy required to produce 1 m³ of fresh water decreased by over 64% [10]. It is more difficult to estimate brackish water cost because of water quality and quantity changes from site to site and sometimes even at the same site [11]. But, brackish water cost is always lower than SWRO mainly due to lower salinity feed water which requires lower applied pressure and allows higher recovery. This causes a lower energy consumption per unit volume of water produced and a substantially lower investment cost. Low cost potable water quality from a brackish water source can also be achieved by electrodialysis reversal (EDR) technology. A very large scale brackish water desalination plant, with a total capacity of 200,000 m³/d and using EDR technology, was built recently in Barcelona, Spain. Typically, EDR is selected over RO for systems that have a particular water chemistry issue, such as a high sulfate to chloride ratio in the raw water.

Although desalination is expensive compared to conventional treatment of fresh water, the cost of desalination, particularly RO, is decreasing, while the costs for developing new fresh water sources of potable supply are increasing or no longer possible. Membrane prices have significantly dropped in the last decades. Prices of thermal processes are also falling due to material improvements, process innovation, and increasing competition. Also, as technological developments cause a reduction in the cost of equipment, the overall relative plant costs are expected to decline. This trend has made desalination, once a costly alternative to the provision of potable water, a viable solution and economically competitive with other options for water supply. Fig. 3 shows the cost trends for different

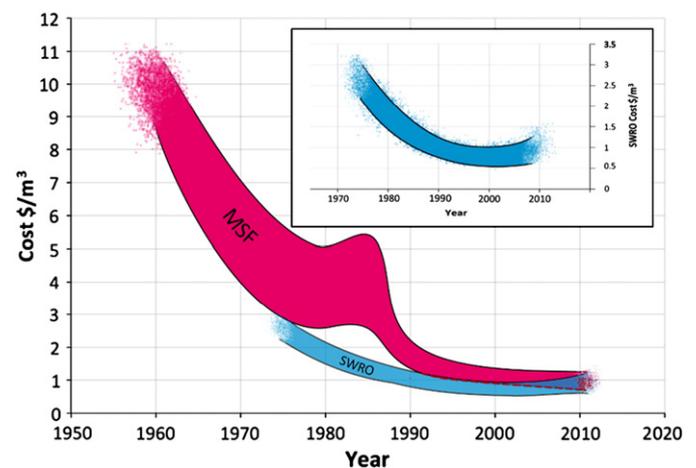


Fig. 2. Unit water cost trends by SWRO and MSF processes.

Table 2
Main improvements of thermal processes.

MSF	MED	VC
-Process and individual equipment designs optimization -Typical unit size increased from 19,000 to 90,000 m ³ /d -Increase of brine chamber load -Improved plant reliability, thermal performance (Performance Ratio above 9 [13]) -TBT ^a gradually increased from 90 to 112 °C and now to 120 °C -Materials of construction and structural aspect improved (low cost materials) -Reduction in the installation costs despite the increased cost of raw materials and labor costs -Use of hybrid systems (thermal–thermal and thermal–other technologies such as MEE-TVC, MSF-RO, MSF-MEE ^b and air cooling systems) [13] and addition of membrane softening of feed water	-Typical unit size increased from 3800 to 22,700 m ³ /d. -Scaling problems reduced by proper condenser tube bundle design and evaporating saline water distribution -Improved heat transfer coefficients with proper heat transfer surfaces [14] -Stabilization of low temperature operation and use of Aluminum for heat transfer surfaces -TBT ^a is maintained at 70 °C -Use of TVC ^c with MED	-VC is generally integrated with MED plants -They are generally used for small or medium scale applications [15,16] -Two types of VC (TVC ^c and MVC ^d) -Typical unit size increased by 5 times; now about 3800 m ³ /d. Energy consumption is reduced; it is less than 6 kWh/m ³

^a TBT: top brine temperature.

^b MEE: Multi Effect Evaporation.

^c TVC: thermal vapor compression.

^d MVC: mechanical vapor compression.

raw waters treated by RO [12]. It shows that the cost of desalination and water reuse has reduced to a level comparable with traditional water supply options. RO desalination cost includes all the treatment steps including pretreatment and post-treatment processes but excluding water distribution costs. The overall decline in cost trend may significantly decrease or could reverse based on current, substantial increases in conventional energy production costs.

5. Technology developments that have contributed to cost reduction

5.1. Thermal processes

The main factors that contributed to cost reduction in all desalination processes are the significant improvements in the performance of these technologies during the last few decades. The main improvements in thermal processes are summarized in Table 2. In addition, the BOO and BOOT contract delivery mechanisms, which changed from technical to functional, have allowed project bidders to further optimize plant design and operation, which has helped in reducing the cost.

More details on developments that have contributed to cost reduction are presented in Section 6.

5.2. Membrane processes

Many recent and important improvements in desalination technologies are in RO systems. The total desalination capacity worldwide using RO technology is continuously increasing, even in the Arabian Gulf region where energy is cheap and raw water quality is less suitable for RO technology, requiring an advanced pretreatment scheme to protect RO membranes mainly from fouling and biofouling [17].

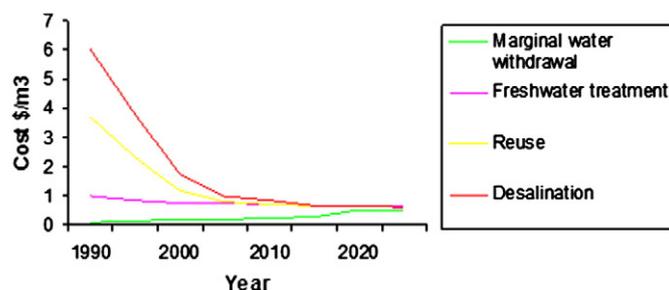


Fig. 3. Water resources cost trends [12].

The total global capacity (sea and brackish waters) of RO is the highest compared to any other process (Fig. 1). The tremendous reduction in desalinated water cost by RO has enabled many countries to implement desalination to supply potable water for domestic and industrial use and even for agriculture purposes in some countries such as Spain [18].

There have been many developments over the last three decades that have contributed to a reduction in unit water cost of RO desalination, particularly membrane performance and reduction in energy consumption caused by more efficient energy recovery systems. The performance of the membrane materials and modules has improved with respect to increased salt rejection, increased surface area per unit volume, increased flux, improved membrane life, and capacity to work at higher pressure, and has also a decreased membrane cost. The recovery ratio increased considerably over the years due to improved salt rejection. The recovery ratio for normal seawater desalination (35,000 mg/L of salinity) was about 25% in 1980s and it increased to 35% in 1990s. Currently, it is about 45% and can reach 60% if second stage is applied. Significantly lower recoveries occur in locations where seawater salinities are usually high, such as the Arabian Gulf, the Red Sea, and the eastern Mediterranean Sea, but recoveries in these difficult areas have also historically improved. Improved recovery has facilitated a decrease of the investment cost and also operating costs. The capital cost reduction occurs because of the reduction in RO train and intake and outfall system capacities caused by the improved conversion rate of seawater to fresh water. The operating cost reduction is due to a reduction in usage of chemicals and pumping energy [19].

Membrane costs should increase due to inflation over a period of time. The significant decrease of membrane costs of the last decades has contributed considerably to unit water cost reduction.

Perhaps the energy component has witnessed the most dramatic improvement in RO processes. The energy is recovered from the brine side of the process through either turbo systems that include reversible pumps, Pelton turbines, turbochargers, and a hydraulic pressure booster or through volumetric systems that include the ERI pressure exchanger, DWEER (Dual Work Exchanger), or the KSB (SalTec) devise. Other new energy recovery systems are under development with the objective of reducing energy consumption for SWRO below 2 kWh/m³. Typical energy consumption for different desalination technologies is presented in Table 3, Section 6.2.

The other important improvements in RO technology are:

- Improvements in pretreatment processes (including microfiltration (MF)/ultrafiltration (UF) membranes). Most of the new plants are

- using lesser amounts of chemicals, which is more environmentally friendly and results in a great reduction in consumable costs [20].
- Development of new intake designs, mainly conventional wells [21], horizontal wells or drains, or gallery intakes [22]. These types of natural filtration systems are very suitable for treatment of difficult raw water qualities to minimize impingement and entrainment [23], and reduce quantities of chemicals used, especially during red tide events or high harmful algal blooms [21,22]. In open intakes, a more suitable pretreatment is required to deal with red tides. Dissolved air flotation (DAF) is the best solution for red tides today.
 - Improvements in design with use of different configurations and improvements in linking processes.
 - Development of a high boron rejection membranes that produce an acceptable concentration in the permeate without requiring a second pass RO system [24].
 - Reduction in usage of chemicals with improved membrane performance. Injection of acid and antiscalant is not always necessary. A recent study showed stable operation of a SWRO plant free of chemicals without causing any scaling [25]. In addition, the use of low pressure membranes in SWRO pretreatment can reduce or avoid the use of coagulation agents [20].
 - Increase in plant capacity (plant size and unit size) provides a scaling factor that reduces cost, particularly capital cost per treatment capacity unit (Fig. 4).

Apart from improvements in RO technology, increases in plant capacity have also contributed to a reduction in unit water cost (Fig. 4) [18]. The magnitude of the respective costs due to improvements in the membranes and increases in plant capacity are difficult to measure since they have both taken place simultaneously. Plant capacities increased by a factor of 10 between 1995 and 2010. The Maqtaa SWRO plant located in Algeria, which is under construction, will have a total capacity of 500,000 m³/d [26].

5.3. Hybrid systems

Two or more desalination processes can be combined or coupled with a power plant in a hybrid configuration to produce water at low cost. Where there is considerable fluctuation in water and power demands, it is very suitable to use hybrid desalination systems (co-generation power-MSF plant with SWRO plant). In general, MSF or MED is combined with VC and RO or nanofiltration (NF). Combination of processes and power production can more efficiently utilize fuel energy as well as the produced power. For utilization of idle power to produce water via RO or MVC, the additional produced water can be stored in aquifers and recovered when demand is higher, thereby increasing overall system efficiency and reducing cost [27].

There are many advantages of hybrid systems. Different desalination technologies can use common intake and outfall systems to reduce pumping energy and decrease the cost of civil works. Also, the feed water temperature to the RO process can be maintained

constant during the seasons using the available waste heat from thermal brine discharge. Use within the RO process, in turn, helps cool the water to acceptable temperatures before the concentrate is returned to the sea, thus, better meeting discharge regulations related to thermal discharge cooling water. Furthermore, integrated pretreatment and post-treatment can reduce energy and chemical consumption.

When thermal-based and membrane-based technologies are used simultaneously, the product waters of both processes can be blended to obtain the required product quality for potable use. Also, a second pass RO may not be required, if blending is used to obtain specific water quality (addition of hardness). This combination significantly reduces the investment and total water costs. For example, a plant producing 150,000 m³/d with an optimum capacity ratio of SWRO to MSF/MED of 2 (i.e. 100,000 m³/d RO and 50,000 m³/d MSF/MED), the total water cost is decreased by US\$0.064/m³, which creates an economic benefit of approximately US\$3.4million/year. The total savings used for this benefit were derived from the economic assessment of hybrid system graphs developed by Awerbuch [28].

6. Parameters influencing the desalination cost

6.1. Main parameters influencing the cost

The parameters that affect the total investment (capital) and operational costs of desalination plants are the major factors considered in selection of an appropriate desalination technology. The estimated cost of desalination with different processes is site-specific and depends mainly on the following parameters:

- Electric power availability. If a plant is going to be a stand-alone facility powered by electricity generated at a considerable distance away, the RO process may have greater economic advantage over a thermal or hybrid process.
- Desalination process configuration, plant size and its component design. The investment cost of different commercial desalination technologies differs widely between thermal-based and membrane-based technologies (Table 3). For a similar plant capacity, thermal processes require larger footprints and use more costly materials and equipment than the SWRO process. Similarly, thermal processes consume higher amounts of specific energy (electrical and thermal) than RO (needs electricity only) and more chemicals are required to control scaling, corrosion and foam. However, on the other hand, thermal distillate is of higher quality than the RO product. Also, thermal processes function using nearly any quality (salinity) of feed water without extensive pretreatment. Plant capacity is also an important issue. Normally, the higher the plant capacity, the lower the total water cost and investment cost per cubic meter of product (Fig. 4). However, political or environmental issues could be a limitation for successfully implementing such mega-projects.
- Geographical location and site-specific characteristics. Desalination plants with a required production capacity should be built in appropriate locations to avoid additional costs, such as water transfer or not running the plant under its optimal conditions. Real estate acquisition cost is also a significant factor that may require greater water transmission in locations where land cost may exhibit orders of magnitude differences in relatively short distances.
- Raw water quality, temperature, intake arrangement and required product water quality (post-treatment, blending). The plant location should be carefully selected at the best site in terms of feed water quality, elevation or currents especially for RO as the cost could be significantly affected by the quality of feed water if more advanced pretreatment is required. For example, biofouling reduces the membrane life-expectancy and increases the operation and maintenance (O&M) costs and, in some cases, has led to temporary plant shutdowns. Intake and pretreatment arrangements are

Table 3

Energy consumption and water cost (average values) of large scale commercial desalination processes [2–4,8,13,14,16,18].

Process	Thermal energy kWh/m ³	Electrical energy kWh/m ³	Total energy kWh/m ³	Investment cost \$/m ³ /d	Total water cost US\$/m ³
MSF	7.5–12	2.5–4	10–16	1200–2500	(0.8–1.5) ^a
MED	4–7	1.5–2	5.5–9	900–2000	0.7–1.2
SWRO	–	(3–4) ^b	3–4	900–2500	0.5–1.2
BWRO	–	0.5–2.5	0.5–2.5	300–1200	0.2–0.4

^a Including subsidies (price of fuel).

^b Including energy recovery system.

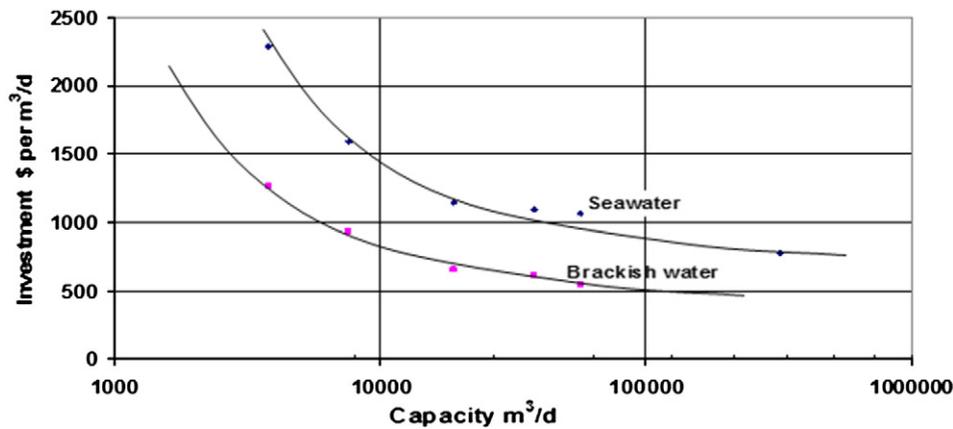


Fig. 4. Investment costs in RO processes vs. capacity [18].

designed depending on raw water quality and quantity as well as geology of the site.

- Reject discharge type and product water storage. New environmental regulations continuously oblige designers and plant constructors to develop advanced methods for concentrate discharge [29]. Concentrate salinity and chemistry, temperature (for thermal processes), and waste chemicals are the main concerns [29,30]. New regulations require dilution of the concentrate in a mixing zone, reduction of brine temperature by cooling water, and removing the chemicals before discharging it into the sea (e.g., dechlorination).
- Post-treatment of the product water. The pH and hardness of desalinated water require readjustments to make the water acceptable for potable use [31]. In general, desalinated water, after post-treatment, is introduced into the water distribution system.
- On-site storage of product water. Depending on the reliability of the treatment plant infrastructure and the electric power source and the need for storage of produced water for emergency periods, on-site storage capacity can range from a few hours of plant capacity up to about 5 days of capacity. At the large desalination plants in the Middle East region, only a small amount of water is stored in tanks in case of a reduction in water production due to routine or an unexpected shut down [32].
- Product water recovery and energy price. The energy price is included in the contract agreement for the service period as part of the total water cost. However, virtually all BOO and BOOT contracts contain an energy adjustment cost provision to cover variations (mostly increases) in electric power costs. Therefore, minimization or reduction in the facility energy consumption has a major impact on reducing the unit water cost (Fig. 7).
- Materials, equipment, chemicals and other consumables.
- Financing details and amortization period as well as inflation.
- Contract (land and construction, cost inflation during the life of the plant), interest rate changes, and administrative overheads.
- O&M, membrane replacement, equipment replacement (particularly pumps and header pipes), skilled labor costs and training requirements. The availability of qualified personnel results in higher production capacity with less shutdown and consumables use [1]. However, in regions where the skilled labor pool is insufficient or non-existent, operational costs can be higher due to higher wages for plant workers (imported skilled labor) or plant inefficiencies caused by poor operation.
- Investment and capital costs depend strongly on the above parameters, especially the desalination process.
- Specific details of the water purchase agreement, regulatory requirements and political risks (higher financing rates).
- Competitive bid/contract type (BOO, BOOT, IWPP).
- Performance standard. Many BOO and BOOT bid tenders contain a minimum performance reliability standard. Typically, a 95% standard

is applied. If a 98% standard is applied, there is a substantial increase in CAPEX because of the increased requirement for redundancy of equipment. The big issue is loss of production and it is huge. It can be as much as US\$1 million/d and CAPEX is not the driver—OPEX is the key. In mega-plants, one additional train (unit) is usually used as a spare that operates in emergencies. Use of the excess capacity can decrease the flux and extend the membrane life. It also gives flexibility for regular maintenance (basically 2 weeks/year) and membrane replacement (usually one-fifth to one-seventh of the modules each year) and provides smoother operation in terms of pressure drop. So at 95% uptime, we only have 2.61 weeks off anyway which merely leaves 0.61 weeks for unplanned downtime. The point here is that the desalination plant has to work in conjunction with the mining equipment in order to maximize cash flow. No rational contract contains a 100% reliability standard. There is commonly a penalty clause for not meeting the performance standard.

Another issue to consider here is the capacity of the storage tanks (the tank feeding the pipeline and storage tanks in between and the tank at the site or a covered pond).

6.2. Capital, investment and total water costs

The capital cost includes all expenditures associated with the implementation of a given desalination project from the time of its conception, through design, permitting, financing, construction, commissioning and acceptance testing for normal operation [33]. Capital cost is often referred as CAPEX or Capital Expenditure [34].

TWC or life-cycle cost is the sum of capital cost and operating cost for the contract period (Fig. 5). The cost is calculated by dividing the sum of the amortized (annualized) capital costs and the annual O&M costs by the average annual potable water production volume. In general, TWC excludes the distribution costs, particularly in alternative delivery contracts (in municipal water costing, the distribution costs are included in the overall water cost assessment) [33]. O&M costs are site-specific and consist of fixed costs and variable costs. Fixed costs include insurance and amortization (annual interest for direct and indirect costs) costs. The primary variable operating costs (OPEX) include the cost of labor, energy, consumables (chemicals, membrane replacement, pump replacement), maintenance, and spare part costs, which are dependent on the relationship of facility location to manufacturing and distribution centers.

Capital cost includes direct and indirect costs. Direct capital costs represent the installed process equipment, auxiliary equipment (MSF/MED equipment is generally more costly than RO), and the associated piping and instrumentation, site civil works, intake (may include wells, open or sub-surface intakes) and brine discharge (may include outfall, injection wells, evaporation ponds) infrastructures, buildings,

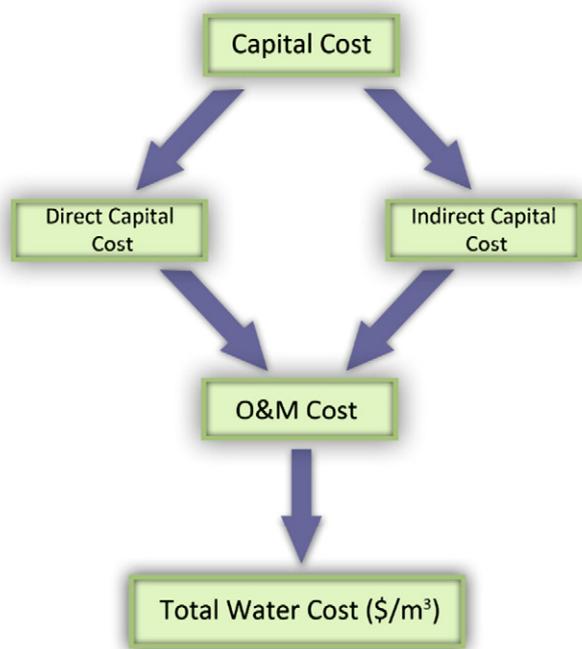


Fig. 5. Diagram of TWC analysis for desalination processes.

roads and laboratories. Land cost depends on the contract agreement and may vary from zero to an agreed lump sum depending on the site characteristics [35]. Construction costs are typically 50–85% of the total capital cost. Indirect capital costs represent interest during construction (overheads), working capital, freight and insurance, contingencies, import duties (in some cases waived), project management, and architectural and engineering (A&E) fees. These costs are usually calculated as a percentage of the direct capital costs with an average of 40% [35], 15–50% [33] or 30–45% [36], but are very project specific.

The investment cost depends strongly on the mentioned parameters. Table 3 provides the estimated minimum and maximum limits of investment and TWC for different technologies of recent, newly contracted and commissioned projects. The actual energy consumption is four times higher than the minimum energy required to produce fresh water from seawater (thermodynamic limit of desalting typical seawater (35 g/L) is 0.78 kWh/m³ for 0% recovery and 1.2 kWh/m³ for 50% recovery, which is closer to an RO system recovery). Fig. 4 shows the difference in investment cost for RO plants of different sizes [18]. The same general trend of the curves is observed for seawater and brackish water. TWC and investment costs of the Barcelona brackish water EDR plant, having a total capacity of 200,000 m³/d and feed salinity of 2 g/L (obtained product < 400 ppm), are US\$0.26/m³ and US\$79.56 million, respectively [2]. TWC for large-scale thermal process facilities ranges from US\$0.80 to 1.50, US\$0.70 to 1.20, and US\$0.60 to 1.00/m³ for MSF, MED and VC, respectively. However, it is important to mention that the total energy consumption for each technology is a better parameter in comparing the cost as in most cases energy (especially thermal) is highly subsidized by governments in energy rich countries making the TWC an ineffective parameter for cost comparison between plants located in different countries.

6.2.1. Energy consumption

The breakdown of the total energy consumption of two real SWRO plants, typically reported as 3–4 kWh/m³ excluding water distribution systems (Table 3), is presented in Fig. 6. Both plants use similar conventional pretreatment and open intakes.

In MED the specific power consumption is below 2 kWh/m³ of distillate, which is significantly lower than MSF which is typically

4 kWh/m³. The major advantage of the MED process, however, is the ability to produce significantly a higher performance ratio in excess of 8.6 kg of the product per 0.45 kg of steam whereas the MSF practical limit is only 10.

If the corrosion and scaling potentials are reduced through some means such as the application of the NF membrane softening process, then these plants can be operated at higher temperatures with a corresponding increase in efficiency and significant decrease in the cost [28].

The described improvements helped in reducing the unit water cost produced by MSF to less than US\$1.00/m³ for large-scale plants. The investment cost of large MSF plants is about US\$1500/m³/d capacity based on the average value of recently contracted plants installed in the Middle East. Additionally, MSF contractors have been able to reduce the construction time, thus implementing large turnkey projects within a period of close to one year, which is responsive to meeting water shortages on an emergency basis. A typical unit water cost breakdown for an MSF plant is given in Fig. 7-left [33]. Energy (mostly steam) and capital recovery represent 74% of the MSF cost, O&M 17%, and spare components 9%.

The investment cost of a recent large scale SWRO desalination plant ranges between USD \$900 and 1200/m³/d capacity. A smaller plant can reach US\$2500/m³/d capacity. A typical unit water cost breakdown for a SWRO plant is given in Fig. 7-right [33]. TWC varies between US\$0.5 and 1.20/m³. Capital, energy and membrane replacement costs constitute the major components of TWC. Capital amortization constitutes 35% to 45%, whereas electric power is 19% to 40% of the TWC. Conversely, in BWRO, energy represents about 10% of the total cost due to a lower operating pressure, 65% capital amortization, and 25% O&M and labors costs [33].

Also, it is important to note that the number of operating RO plants is increasing worldwide including in energy-rich countries as RO capital cost is lower than MSF and the technology has had tremendous developments. Even MED costs, which are comparable to RO, have declined, but there are many fewer MED plants being constructed. This phenomenon is observed for new projects with water and power production on the same site where RO is built along with very large scale power plants, such as the case of the Barka and Dhofar plants in Oman. This trend towards selective use of RO over a thermal process reflects the flexibility and simplicity of bidding requirements for the RO process.

6.3. Cost of some recent desalination projects

Some recent TWCs of various desalination plants using different technology and contract types are summarized in Table 4. It shows costs with significant differences in total price even for similar plant capacities and project types. In some projects, water price is high due to specific conditions like the necessity to install complex pretreatment systems or because of severe environmental regulations that increase permitting and construction costs. A detailed list of several seawater desalination plants installed around the world and their associated TWCs were published in DWR 44-33 [2] and Huehmer et al. [34].

7. Variation in the cost of desalinated water

Fig. 8 shows that the TWC decreased significantly from 1991 to 2003 mainly due to the technological developments described. But, when TWC is extended a little further into the future, the projected cost curve begins to turn upwards (dotted line). For the low unit price of the Singapore plant (US\$0.47/m³) [9], the cost is based on a guaranteed minimum water production significantly lower than the plant production capacity [8]. Ashkelon is an impressive case since the cost is low even though the salinity of feed water is higher and the product has a chloride limit of 35 mg/L and a boron limit of 0.4 mg/L. However, it was reported that TWC was adjusted many

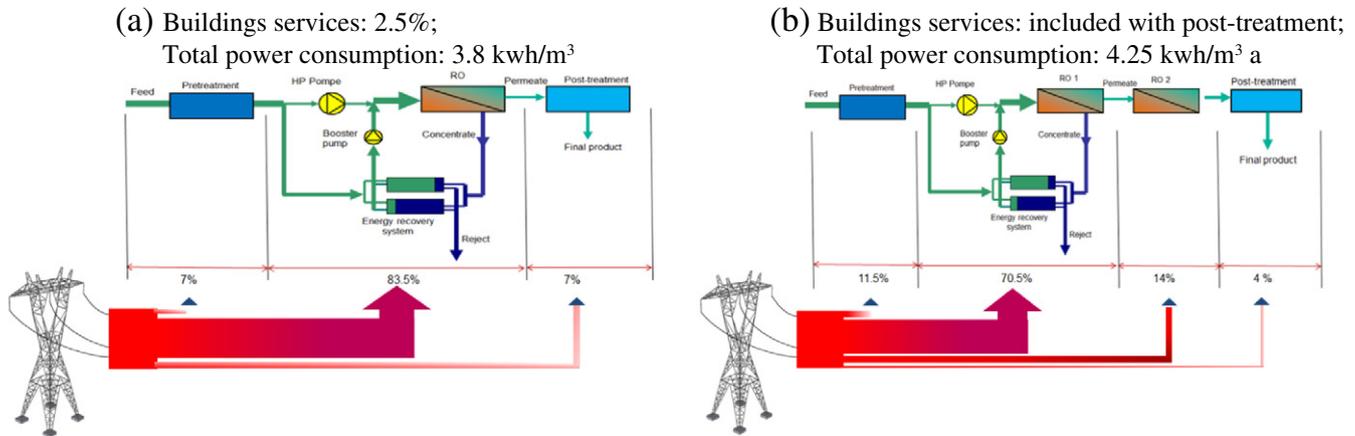


Fig. 6. Energy consumption in SWRO: (left) one-pass RO, salinity = 35 g/L; (right) 2-pass RO, salinity = 39 g/L.

times and increased to US\$0.655/m³ in 2006 and to US\$0.778/m³ in 2008 [18]. Some projects include extraordinary costs such as complicated offshore intakes or extensive environmental mitigation measures.

The use of different methodologies by different construction companies could be one of the reasons that such differences in estimating the water cost occur, even for similar projects because the main parameters influencing the cost such as salinity, plant size, technology, energy cost, and regulatory requirements are known in advance and should not affect the TWC. However, other specific parameters such as subsidies, financial and political risks are also contributing to evaluation of the costs, causing some variations in observed project bid values.

Cost of desalination commonly is not directly related to charges for delivered potable water charged by a utility or contractor. There are no precise rules to estimate comparable prices charged for desalinated water even for similar conditions and plant types, because the costs added for administration, delivery or special delivery covenants (profit) are quite variable. Therefore, a uniform cost estimation technique developed for desalination will benefit water users and utilities using a contractor to provide water to evaluate actual delivery costs within a global context.

7.1. Some reasons for the recent increased TWC and the impact of emerging desalination technologies on cost variation in the future

After extensive investigation of the TWC evolution over the last decades and for recent projects, the authors join the expectation of many desalination experts that the desalinated water cost will not

reduce further at the same rate of decline for several reasons. The primary reasons are the instable prices of crude oil (affects energy costs), currency fluctuations, and increases in membrane prices. Membrane prices were kept stable in the last years by technology improvements and competition causing many companies to operate at low profit margins. Many membrane manufacturers predict that there is no way to avoid membrane price increases in the near future [8]. Most of the membrane manufacturers have already increased the prices of their products. Another important issue is the increased costs of energy, shipping, raw materials (particularly specialty metals), equipment and chemical prices along with more restrictive environmental regulations. Furthermore, in some projects, intake and reject disposal systems costs are higher than the cost of the entire capital cost of a similar plant in another country where restrictions are not severe (e.g. Australian plants). Short supply of highly skilled manpower for plant construction and O&M could also be a factor in cost increases [1,37]. Finally, currency fluctuations and inflation will oblige constructing companies to increase their financial risk percentage within the financing framework.

Expected improvements in existing technologies, such as optimization of chemical dosing, post-treatment [31], and new cleaning methods (without shutting down the desalination unit) may not significantly reduce the cost of desalination in the future.

Existing desalination technologies are mature and desalinated water cost reductions will be marginal due to further developments in technologies. However, there is some scope of improvements in membrane processes due to improved membranes, higher efficiency pumps and energy recovery systems (including integrated systems)

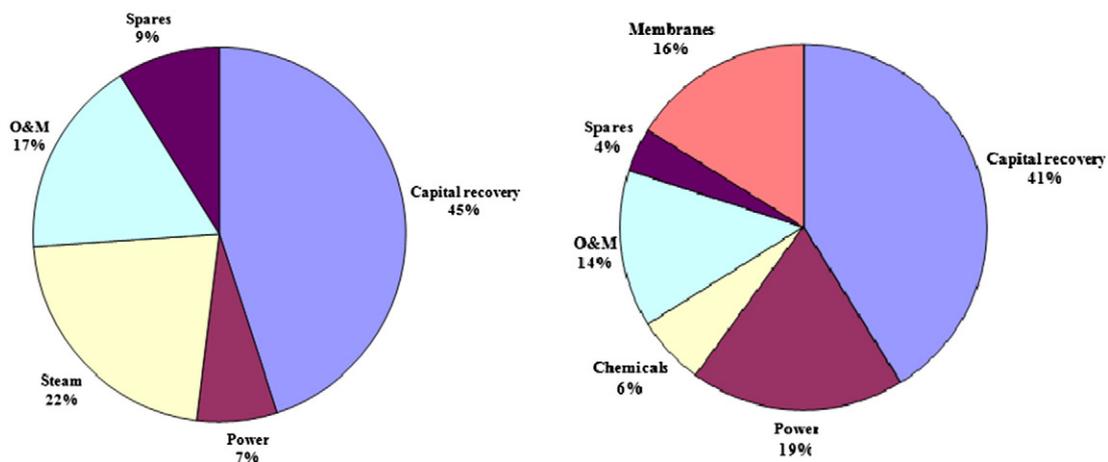


Fig. 7. Unit water cost breakdown for MSF (left) and RO (right) [33].

Table 4
Water cost of different recent large scale projects [2,8].

Site	Start-up	Capacity (m ³ /d)	Contract type	Capital cost (USD)	TWC (\$/m ³)
Fujairah 2 MED/SWRO	2011	460,000/136,000	IWPP	\$616M/\$190M	
Adelaide SWRO 2-pass	2011	273,000	DBOM ¹	\$1.79B	
Sydney SWRO 2-pass	2010	250,000	DBO ²	\$933M	
Hadera SWRO	2010	347,900	BOOT	\$425M	0.63
Shuaiba MSF	2010	880,000	BOO	\$2.4B	0.95
		900MW			
Barka 2 SWRO 2-pass	2009	123,500	IWPP	\$800M	
Marafiq MED-TVC	2009	800,000	IWPP	\$3.4B	0.83
Skikda SWRO	2008	100,000	BOT ³	\$110M	0.73
Ras Laffan B MSF	2008	272,500	IWPP	\$900M	0.80
		1025MW			
Oxnard BWRO	2008	28,400		\$25M	0.31
(salinity = 1.38 g/L)					
Alicante 2 SWRO	2008	65,000	DBO	\$89M	
Hamma SWRO	2008	200,000	BOO	\$250M	0.82
El Paso BWRO (2.55 g/L)	2007	55,670	DBB ⁴	\$87M	0.41
Perth SWRO 2-pass	2007	143,700	BOT	\$347M	1.20
Palmachim SWRO	2007	110,000	BOO	\$110M	0.78
Rabigh MED-TVC	2005	25,000	BOOT		1.15

¹ DBOM: Design Build Operate and Maintain.

² DBO: Design Build Operate.

³ BOT: Build Own Transfer.

⁴ DBB: Design Bid Build.

and pretreatment methods. New design configurations (inter-staged membrane operations) [38] and use of forward osmosis [39] can also reduce energy consumption in SWRO. The use of 16-inch RO modules can also have an impact on cost (mainly lower footprint) despite the fact that designers of construction companies are still reluctant to use these mega-modules which were developed several years ago. Other technological improvements in advanced membrane materials such as development of sulfonated polysulfone composite RO membranes that are highly resistant to chlorine attack (better biofouling control) [40] are foreseen, which could have an effect on reducing the cost as well [7].

However, development of new low-cost technologies such as adsorption desalination [41], membrane distillation (MD) and new hybrid systems using renewable energies and low grade waste energy will likely bring the cost down, but implementation of these new technologies will take some time to compete with the existing processes.

In thermal processes, there could be some improvements in the future with the use of NF process for pretreatment in order to control scaling at higher top brine temperatures [42], and development of thermal-based hybrid systems using renewable energies such as geothermal, solar or wind energies [43–46].

8. Review of existing desalination costing methodologies

Details of the most well-known software packages for estimating the capital and O&M costs for various desalination processes, such as DEEP “Desalination Economic Evaluation Program” and WTCost®, developed by International Atomic Energy Agency (IAEA) [47] and the US Bureau of Reclamation with the assistance of I. Moch & Associates and Boulder Research Enterprises, respectively, were presented by Reddy and Ghaffour [4]. The seawater desalting costs program of Leitner and Water Resources Associates (WAR) was also discussed [4,48].

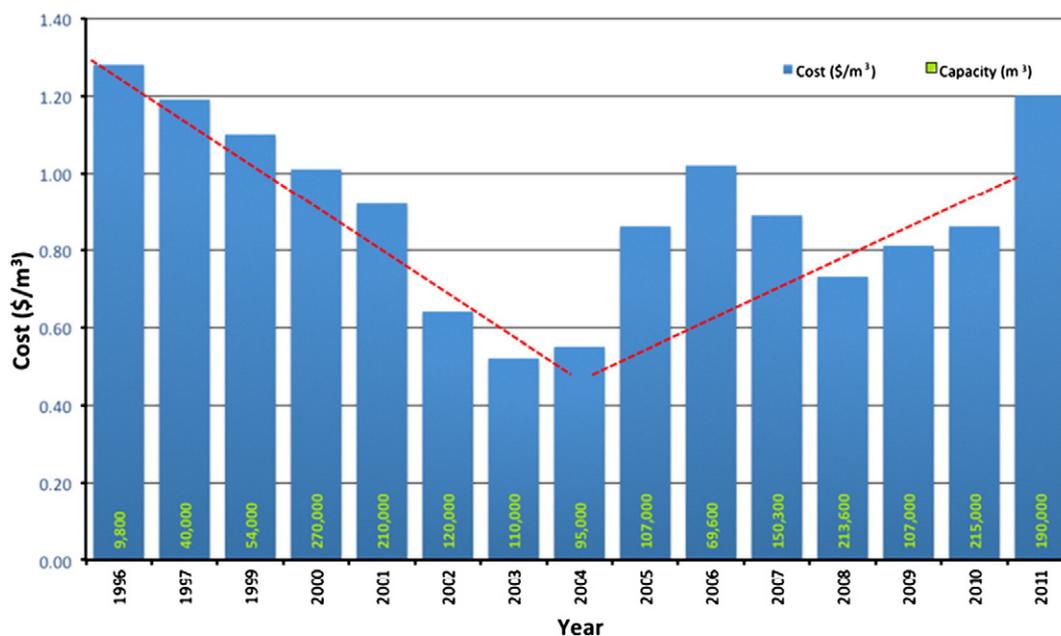


Fig. 8. TWC of different SWRO plants in operation and contracted (average capacity ‘m³/d’ and average cost ‘US\$/m³’ for each year).

Desalination cost assessment methods are required by many different types of users and for different purposes, thus there are different accuracy requirements. In general, plant suppliers and consultants develop their own spreadsheet cost estimation methods which are proprietary and generally with less transparency. Other specialists use the published tools such as DEEP, WTCost© and SWRO cost estimator [2]. To evaluate the accuracy of these tools, different authors have used these software packages [35,49–51] which were recently developed for different RO and thermal desalination plants in operation in order to evaluate the calculated costs and compare them with actual data for the same conditions. Estimated costs of the same plants were found to have varying accuracies with errors as large as 20%. Then, authors used another simple spreadsheet cost calculation prepared by Tua Engineering, Malta, for RO [52] and Ettouney et al. [35] for thermal processes (spreadsheet developed for the Middle East Desalination Research Center (MEDRC) project) and found similar figures which means that the complex parameters used in these software packages are not widely influencing the cost estimates. Similarly, comparable figures were presented by Huehmer et al. [33] using the results of different empirical capital cost models for SWRO developed by different authors [53–57].

If the existing cost estimation methodologies were more transparent, it would help researchers and users to develop more accurate tools taking into account all the possible parameters influencing the water cost in order to converge towards comparable costs. However, reasonable variation in costs is acceptable as it remains site specific. These tools are needed for selection of the appropriate technology for specific sites, selection of optimum production capacity of each technology, including hybrid desalination configurations, minimization of desalinated water cost by optimizing capital and operating costs, and for selection of appropriate desalination technology powered with different energy sources—fossil fuels, nuclear or renewable energies [58–60].

The total project investment (capital) and desalinated water costs are needed by different levels of people and sectors for different purposes as they are the main factors for decision-makers and investors to consider desalination as a solution for potable water supply. Policy/decision makers and planners need these tools for use in feasibility studies and consultants need them for evaluation of tenders. Plant suppliers use cost estimation software packages for evaluation and optimization of their technologies and processes, whereas design engineers use them for process and equipment design optimization. Researchers and technology developers also need transparent cost estimation methodologies for improving existing desalination technologies and for developing new technologies in order to reduce further the cost of desalination.

9. Conclusions

The investment and total water costs are primary parameters used by decision makers to select the appropriate desalination technology for a project based on plant capacity, energy consumption, contract delivery type, and other factors, such as the cost to mitigate for environmental impacts. However, cost depends on many parameters and the accuracy of a cost estimate relies on the use of more transparent, high quality software packages to produce accurate results. Cost data reported is commonly not consistent for different technologies or similar-sized facilities, because they are site-specific. Available cost estimation methods and software packages are of different accuracy with error ranges of ± 10 to 50% [4].

It is quite clear that there is a need to decide on the complexity and content of cost estimation models. Water cost estimation methodologies need to identify and specify all of the parameters that contribute to the desalination cost and develop a structured and transparent procedure for estimation of the desalinated water cost

for any facility. These estimates are needed for project planning and budgeting as well as for feasibility studies.

Desalination costs are decreasing for all technologies, particularly in the last decade with the largest cost reduction occurring in RO technology. The reduction in RO treatment cost has been favored by the growth rate, plant capacity, competition with other technologies, and the vast improvements in RO systems (better process designs, membranes and materials, and lower energy consumption) as well as the simplicity and flexibility of recent project bids. However, the authors believe that desalination costs will not continue to decrease at the same rate in the near future, despite continued improvements in the existing technologies. Equipment, raw materials, and energy costs are rapidly rising which will impact future capital and operating costs.

Environmental guidelines are becoming stricter, particularly in the United States, the European Union and Australia. These regulations cause a significant increase in cost as permitting becomes a major factor (in California the permitting cost can be up to 60% of a major project cost). Similarly, manufacturers of chemicals are under continuous pressure, particularly in Europe to register, evaluate, and obtain authorization for use. This is a costly endeavor and will also reflect on the cost of desalination.

Acknowledgments

The authors wish to Thank Mr. Kenneth Goodboy, Global Director Desalination, Hatch Water, USA, for his advice and Mr. Muhannad AbuGhdeeb, Engineering Specialist at WDRC-KAUST, for his time in designing the energy and cost figures.

References

- [1] N. Ghaffour, The challenge of capacity-building strategies and perspectives for desalination for sustainable water use in MENA, *Desalination Water Treat.* 5 (2009) 48–53.
- [2] Global Water Intelligence (GWI/IDA DesalData), Market profile and desalination markets, 2009–2012 yearbooks and GWI website, <http://www.desaldata.com/>.
- [3] K. Quteishat, Desalination and Water Affordability, SI'Teau International Conference, Casablanca, Morocco, January 2009.
- [4] K.V. Reddy, N. Ghaffour, Overview of the cost of desalinated water and costing methodologies, *Desalination* 205 (2007) 340–353.
- [5] N.M. Wade, Technical and economic evaluation of distillation and reverse osmosis desalination processes, *Desalination* 93 (1993) 343–363.
- [6] J.E. Miller, Review of water resources and desalination technologies, in: Report 2003-0800, 54, Sandia National Laboratories, 2003.
- [7] L.F. Greenlee, D.F. Lawler, B.D. Freeman, B. Marrot, P. Moulin, Reverse osmosis desalination: water source, technology, and today's challenges, *Water Res.* 43 (2009) 2317–2348.
- [8] T. Pankratz, MEDRC workshop on Membrane Technology Used in Desalination and Wastewater Treatment for Reuse, www.medrc.org March 2008 (Muscat, Oman).
- [9] F.H. Khand, Supply of desalinated water by the private sector: 30 MGD Singapore seawater desalination plant, in: MEDRC International Conference on Desalination Costing, Conference proceeding, Lemesos, Cyprus, December 2004.
- [10] T.M. Missimer, S.A. Storves, Feedwater quality variation and the economics of water plant operation: the Island Water Association brackish water RO treatment facility, Sanibel Island, Florida, in: Proceedings of the World Conference on Desalination and Water Reuse, Bahrain, 2002, (11 pp.).
- [11] W. Arras, N. Ghaffour, A. Hamou, Performance evaluation of BWRO desalination plant—a case study, *Desalination* 235 (2009) 170–178.
- [12] Alfred Stikker, GWI, market profile, *Desalination Mark.* (2006), www.globalwaterintel.com/.
- [13] R. Borsani, S. Rebagliati, Fundamentals and costing of MSF desalination plants and comparison with other technologies, *Desalination* 182 (2005) 29–37.
- [14] C. Sommariva, H. Hogg, K. Callister, Cost reduction and design lifetime increase in thermal desalination plants: thermodynamic and corrosion resistance combined analysis for heat exchange tubes material selection, *Desalination* 158 (2003) 17–21.
- [15] R. Matz, U. Fisher, A comparison of the relative economics of seawater desalination by vapor compression and reverse osmosis for small and medium capacity plants, *Desalination* 36 (1981) 137–151.
- [16] M.A. Darwish, N.M. Al-Najem, Energy consumption and costs of different desalting systems, *Desalination* 64 (1987) 83–96.
- [17] J.S. Vrouwenvelder, C. Hinrichs, W.G.J. van der Meer, M.C.M. van Loosdrecht, J.C. Kruijthof, Pressure drop increase by biofilm accumulation in spiral wound RO and NF membrane systems: role of substrate concentration, flow velocity, substrate load and flow direction, *Biofouling* 25 (2009) 543–555.

- [18] A. Maurel, *Seawater/Brackish Water Desalination and Other Non-conventional Processes for Water Supply*, 2nd edition book Lavoisier, 2006. (10:2-7430-0890-3).
- [19] C. Sommariva, *Desalination Management and Economics* book, sponsored by Mott MacDonald and published by Faversham House Group, UK, 2004.
- [20] S.K. Al-Mashharawi, N. Ghaffour, M. Al-Ghamdi, G.L. Amy, Evaluating the efficiency of different MF and UF membranes used as pretreatment for RO Red Seawater desalination, *Desalin. Water Treat.* (in press), <http://dx.doi.org/10.1080/19443994.2012.699449>.
- [21] N. Voutchkov, Beach wells vs. open surface intake, *Water Wastewater Int.* 19 (2004) 22–23.
- [22] T. Peters, D. Pintó, Seawater intake and partial pre-treatment with Neodren—results from investigation and long-term operation, *Desalin. Water Treat.* 24 (2010) 117–122.
- [23] S. Lattemann, M.D. Kennedy, G. Amy, Seawater desalination—a green technology? *J Water Supply Res. Technol. AQUA* 59 (2010) 134–151.
- [24] K. Rahmawati, N. Ghaffour, G.L. Amy, Boron removal efficiency from Red Sea water using different SWRO/BWRO membranes, *J. Membr. Sci.* 423–424 (2012) 522–529.
- [25] T. Waly, S. Saleh, M.D. Kennedy, G.J. Witkamp, G. Amy, J.C. Schippers, Will calcium carbonate really scale in seawater reverse osmosis? *Desalin. Water Treat.* 5 (2009) 146–152.
- [26] N. Drouiche, N. Ghaffour, M.W. Naceur, H. Mahmoudi, T. Ouslimane, Reasons for the fast growing seawater desalination capacity in Algeria, *Water Resour. Manage.* 25 (2011) 2743–2754.
- [27] R.G. Maliva, W. Guo, T.M. Missimer, Aquifer storage and recovery: recent hydrogeological advances and system performance, *Water Environ. Res.* 78 (2006) 2428–2435.
- [28] L. Awerbuch, Hybridization and dual purpose plant cost considerations, in: MEDRC International Conference on Desalination Costing, Conference Proceeding, Lemesos, Cyprus, December 2004.
- [29] S. Lattemann, T. Höpner, Environmental impact and impact assessment of seawater desalination, *Desalination* 220 (2008) 1–15.
- [30] T. Hopner, S. Lattemann, Chemical impacts from desalination plants—a case study of the northern Red Sea, *Desalination* 152 (2002) 133–140.
- [31] Y. Gacem, S. Taleb, A. Ramdani, S. Senadjki, N. Ghaffour, Physical and chemical assessment of MSF distillate and SWRO product for drinking purpose, *Desalination* 290 (2012) 107–114.
- [32] N. Ghaffour, T. Missimer, G.L. Amy, Combined desalination, water reuse and aquifer storage and recovery to meet water supply demands in the GCC/MENA region, *Desalin. Water Treat.* (in press), <http://dx.doi.org/10.1080/19443994.2012.700034>.
- [33] M. Wilf, L. Awerbuch, C. Bartels, M. Mickley, G. Pearce, N. Voutchkov, *The Guidebook to Membrane Desalination Technology*, Balaban Desalination Publications, 2007.
- [34] R. Huehmer, J. Gomez, J. Curl, K. Moore, Cost modeling of desalination systems, International Desalination Association (IDA) Congress, in: Perth, IDAW/PER11-302, 2011.
- [35] H. Ettouney, H. El-Dessouky, R.S. Faibish, P.J. Gowin, Evaluating the economics of desalination, *Chem. Eng. Proc.* 98 (2002) 32–39.
- [36] I. Moch, J. Moch, A 21st century study of global seawater reverse osmosis operating and capital costs, in: BHR01-16, AWWM Conference, Atlanta GA, USA, March 2003.
- [37] H. Mahmoudi, O. Abdellah, N. Ghaffour, Capacity building strategies and policy for desalination using renewable energies in Algeria, *Renew. Sustain. Energy Rev.* 13 (2009) 921–926.
- [38] M. Elimelech, W.A. Phillip, The future of seawater desalination: energy, technology and the environment, *Science* 333 (2011) 712–717.
- [39] Z. Li, V. Yangali Quintanilla, R. Valladares Linares, Q. Li, T. Zhan, G. Amy, Flux patterns and membrane fouling propensity during desalination of seawater by forward osmosis, *Water Res.* 46 (2011) 195–204, <http://dx.doi.org/10.1016/j.watres.2011.10.051>.
- [40] H.B. Park, B.D. Freeman, Z.B. Zhang, J.E. McGrath, Highly chlorine-tolerant polymers for desalination, *Angew. Chem. Int. Ed.* 47 (2008) 6019–6024.
- [41] K.C. Ng, H.T. Chua, C.Y. Chung, C.H. Loke, T. Kashiwagi, A. Akisawa, B.B. Saha, Experimental investigation of the silica gel–water adsorption isotherm characteristics, *Appl. Therm. Eng.* 21 (2001) 1631–1642.
- [42] M.A.K. Al-Sofi, A.M. Hassan, G.M. Mustafa, A.G.I. Dalvi, M.N.M. Kither, Nanofiltration as means of Achieving Higher TBT of ≥ 120 °C, *Desalination* (1998) 123–129.
- [43] N. Ghaffour, V.K. Reddy, M. Abu-Arabi, Technology development and application of solar energy in desalination: MEDRC contribution, *Renew. Sustain. Energy Rev.* 15 (2011) 4410–4415.
- [44] H. Mahmoudi, N. Saphis, M. Goosen, S. Sablani, A. Sabah, N. Ghaffour, N. Drouiche, Assessment of wind energy to power solar brackish water greenhouse desalination units—a case study, *Renew. Sustain. Energy Rev.* 13 (2009) 2149–2155.
- [45] D. Zejli, A. Ouammi, R. Sacile, H. Dagdougui, A. Elmadaoui, An optimization model for a mechanical vapor compression desalination plant driven by a wind/PV hybrid system, *Appl. Energy* 88 (2011) 4042–4054.
- [46] A. Gastli, Y. Charabi, S. Zekri, GIS-based assessment of combined CSP electric power and seawater desalination plant for Duqum-Oman, *Renew. Sustain. Energy Rev.* 14 (2010) 821–827.
- [47] International Atomic Energy Agency (IAEA), www.iaea.org.
- [48] G. Leitner, Developer selected for 25 MGD Florida West Coast seawater desalting plant, *Desalin. Water Reuse* 9 (1999) 11–16.
- [49] M. Methnani, DEEP: a tool for evaluating co-generated power and desalination strategies, *Desalination* 166 (2004) 11–15.
- [50] J. Moch, M. Chapman, D. Steward, Development of a CD-ROM cost program for water treatment projects, *Membr. Technol.* (2003) 5–8.
- [51] S. Nisan, L. Volpi, Evaluation of desalination costs with DEEP, *Int. J. Nucl. Desalin.* 1 (2004) 298–307.
- [52] A. Tua, Tua Engineering Ltd., MEDRC workshop on Practical Aspects of Membrane Desalination: A review of System Design and Operation & Maintenance (www.medrc.org), Sharm El Sheikh, Egypt, April, 2008, [personal communication].
- [53] I. Watson et al., *Desalting Handbook for Planners*, 3rd edition, US department of the Interior, Bureau of Reclamation Technical Service Center Water Treatment Engineering and Research Group Cooperative Assistance Agreement Number: 98-PG-81-0366, Desalination R&D program number 72, 2003.
- [54] Y. Zhou, R.S.J. Tol, Evaluating the cost of desalination and water transport, *Water Resour. Res.* 41 (2005), <http://dx.doi.org/10.1029/2004WR003749>.
- [55] M.K. Wittholz, B.K. O'Neill, Estimating the cost of desalination plants using a cost database, *Desalination* 229 (2008) 10–20.
- [56] S. Kawamura, W. McGivney, *Cost Estimating Manual for Water Treatment Facilities*, John Wiley & Sons, 2008.
- [57] M.H.I. Dore, Forecasting the economic costs of desalination technology, *Desalination* 172 (2005) 207–214.
- [58] M. Goosen, H. Mahmoudi, N. Ghaffour, Water desalination using geothermal energy, *Energ.* 3 (2010) 1423–1442.
- [59] R.B. Saffarini, E.K. Summers, H.A. Arafat, V.J.H. Lienhard, Economic evaluation of stand-alone solar powered membrane distillation systems, *Desalination* 299 (2012) 55–62.
- [60] H. Mahmoudi, N. Saphis, M.F. Goosen, N. Ghaffour, N. Drouiche, A. Ouagued, Application of geothermal energy for heating and fresh water production in a brackish water greenhouse desalination unit: a case study, *Renew. Sustain. Energy Rev.* 14 (2010) 512–517.